

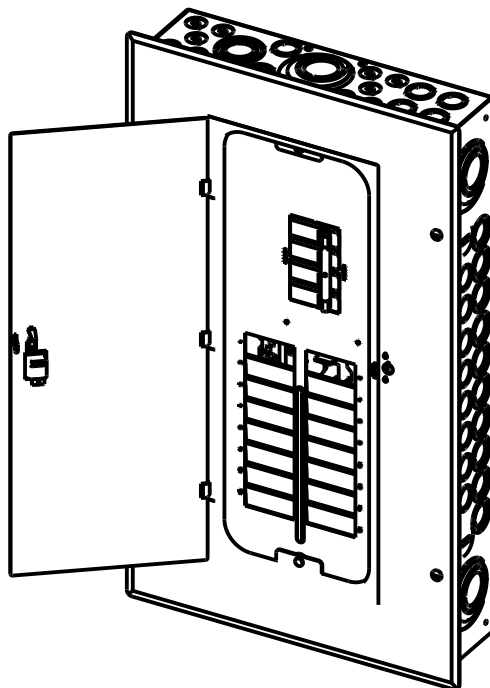
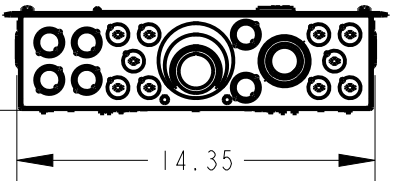



CATALOG

PAM1615
PAM1615W

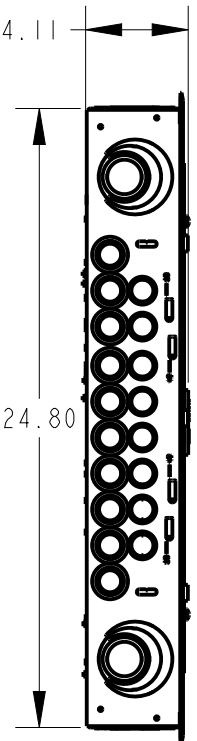

SPECIFICATION	
Service Voltage	120/240V AC, 1 Phase 3 Wire 208Y/120V AC, 1 Phase 3 Wire
Panelboard Amperage	150A Maximum
Short- Circuit Current Rating	100kA @ 240V AC Maximum
Rated Frequency	60Hz
Enclosure Rating	Indoor (Type 1 - UL50E)
Main Device	Circuit Breaker
Main Device Rating	150A Maximum
Busbar Rating and Material	150A Aluminum
Branch Circuit Breaker Rating	125A Maximum
Sum of Circuit Breaker Rating	150A Maximum per Stab
Number of Spaces	16 Spaces Maximum
Number of Circuits	32 Circuits Maximum
Standard Listing	UL67 (E21790)
For bottom feed, rotate the entire device by 180°.	
SUITABLE FOR USE AS SERVICE EQUIPMENT	



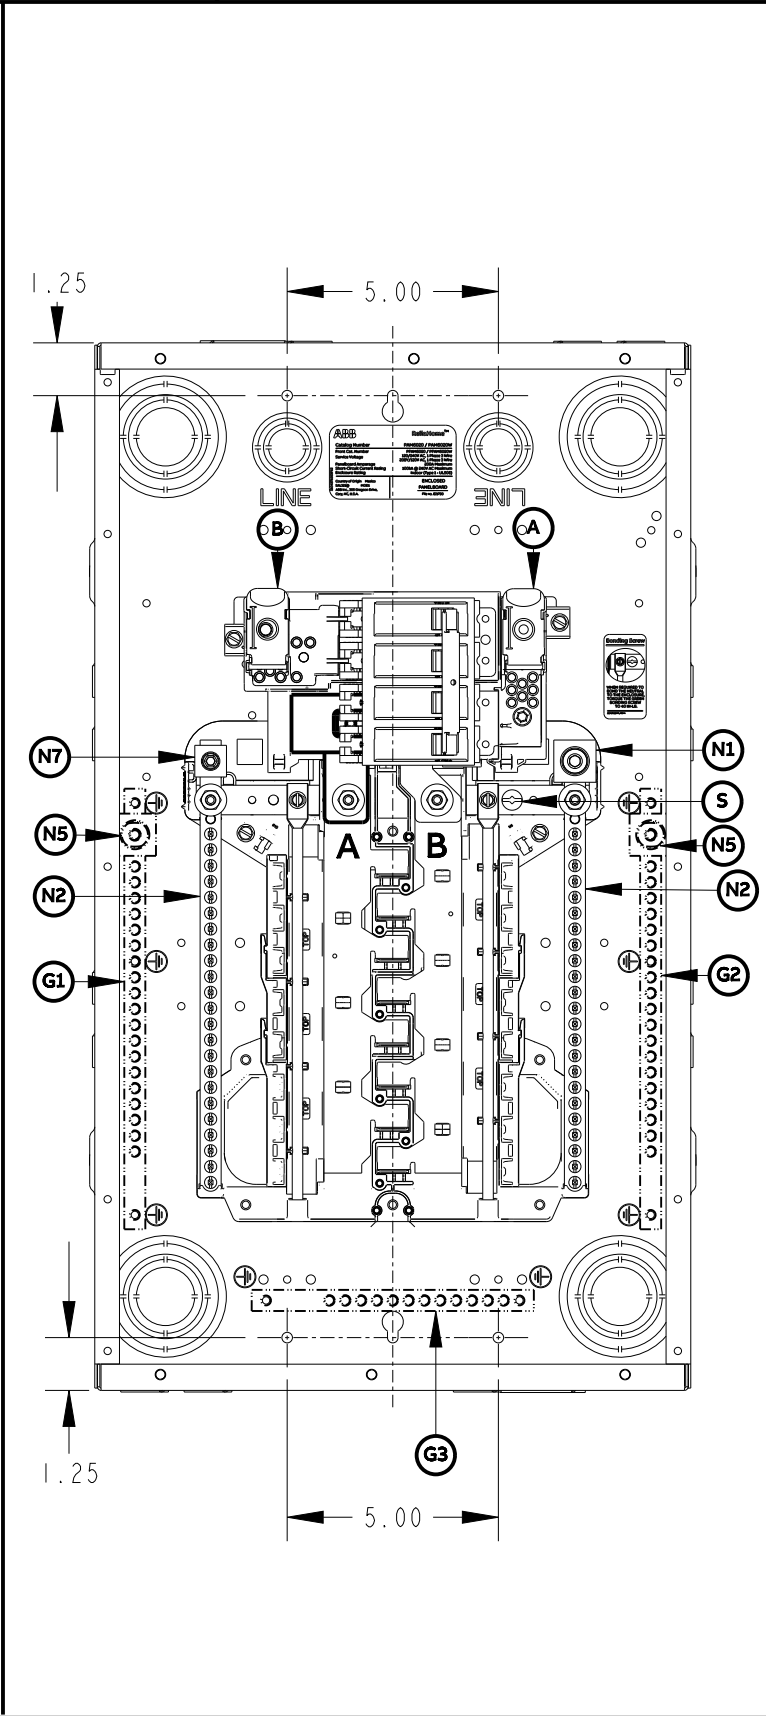

REPLACEMENT / ACCESSORIES KIT		
TQLFP1	1" Front Filler plates	--
PTHQLRK2	Circuit Breaker Hold-down kit END	1TQC163000Z0114
PTHQLRK1	Circuit Breaker Hold-down kit	1TQC163000Z0113
PD60	Circuit Directory	1TQC163000Z0115
THP100	Padlocking - THQL	--
THP100E	Padlocking - AFCI/GFCI	--
THQLSURGE2	Type 1 plug-on SPD	--
THQMV150F	150A Main Circuit Breaker Kit	--
THQMVSBF	Service Entrance Barrier THQMV	--
PFAM1615	Front Replacement Kit (Grey)	--
PFAM1615W	Front Replacement Kit (White)	--
TDL106	Door Lock Kit	--
PLTCHGR	Door Handle Gray	1TQC163000Z0116
PBS	Bond Screw Kit	1TQC163000Z0121
PGENLCK22	Generator Interlock kit 225A	1TQC163000Z0111
THLK2150	Subfeed Lug Kit - 150A, 2Pole	--
PHDWRKIT	P-Series Hardware Kit	1TQC163000Z0123
--	--	--
--	--	--

TORQUE					
Terminal#	Terminal Name	Installed/ Cat.Number	Wire Size	Drive	Torque LB-IN
A & B	Main Circuit Breaker	Factory Installed	#1 - 3/0 Cu; 2/0 - 3/0 Al	Internal Hex	200
N1	Neutral Lug	Factory Installed	(1) #1-300 Cu/Al	Internal Hex	200
N7	Neutral Lug	Factory Installed	(1) #6-2/0 Cu/Al	Internal Hex	120
N2	Neutral Bar	Factory Installed	See Below for Table 1		
N3	Neutral Bar	N/A			
N4	Neutral Bar	N/A			
G1	Ground Bar	TGK12/ TGK24			
G2	Ground Bar	TGK12/ TGK24			
G3	Ground Bar	TGK12			
G4	Ground Lug	N/A	N/A	N/A	N/A
C & D	Feed Thru Lug	N/A	N/A	N/A	N/A
N5	Ground/ Neutral Lug	TNLK20	(1) #6-2/0 Cu/AL	Internal Hex	120
N6		TNLK20	(1) #6-2/0 Cu/AL	Internal Hex	120
N5/N6		TNLK250	(1) #1-300 Cu/AL	Internal Hex	200
--	--	--	--	--	--
--	--	--	--	--	--
S	Bonding Screw	Installed	N/A	Slotted/ Robertson	40

When used as service equipment,
all unused neutral terminals may be used for equipment ground conductors.

Table 1 : GROUND/NEUTRAL Bar Terminal
Wire size (AWG/KCMIL) & Torque


Conductor for Ground/Neutral Bar Terminal					
Solid		Stranded		Drive	Torque Lb-In
CU	AL	CU	AL		
(1) 14	-	(1) 14	-	Slotted/ Robertson	15
-	(1) 12	-	(1) 12		15
(1) 12	-	(1) 12	-		20
(1) 10	-	(1) 10	-	Robertson	20
-	-	(1) 8	-		40
-	-	(1) 6-4	-		45
Multiple Conductor for Ground/Neutral Bar Terminal					
(1) 10 & (1) 12	-	-	-	Slotted/ Robertson	30
(1) 10 & (1) 14	-	(1) 10 & (1) 14	-		30
(2) 10 & (1) 14	-	-	-		30
(1) 12 & (1) 14	-	-	-		30
-	(2) 10 & (1) 12	-	(2) 10 & (1) 12		30



ReliaHome™

P - Series

DRAWING NUMBER	Mod	Rev	Units
1TQC163300E0006	01	D	Inches

KNOCKOUTS						
						
1"-1.25"-1.5"-2"-2.5"	1"-1.25" - 1.5" - 2"	0.75"-1"-1.25"-1.5"	0.5"- 0.75"- 1"	0.5"-0.75"	0.5"	0.281"
X6	X4	X2	X2	X32	X36	X4