

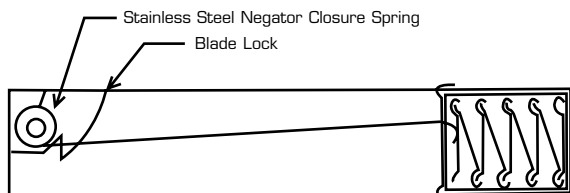


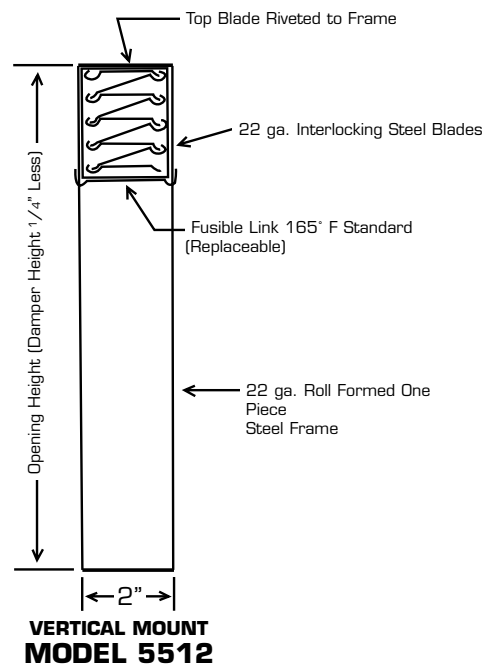

VENT PRODUCTS CO., INC.
1901 South Kilbourn Avenue Chicago, Illinois 60623
Telephone: 773/521-1900
Outside Illinois: 800/368-8368
FAX: 773/521-5613

CERTIFICATION & SUBMITTAL
MODEL 5500 FIRE-TITE™ UL FIRE DAMPERS
Thin "2" Frame
FOR USE IN STATIC SYSTEMS ONLY

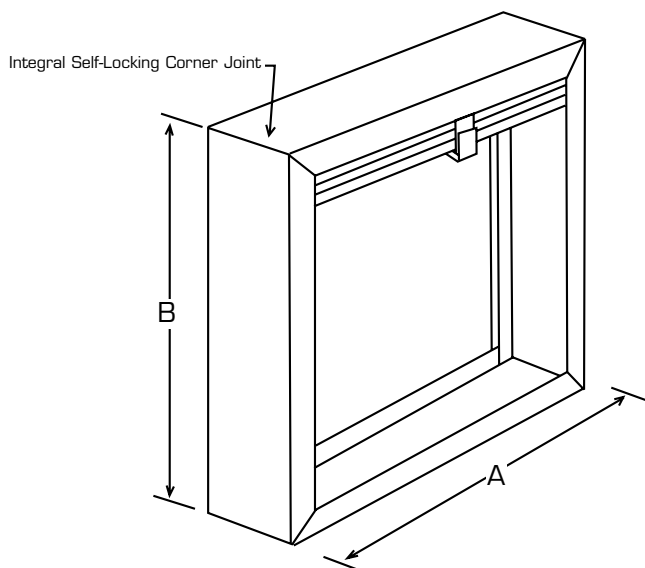

**HORIZONTAL MOUNT
MODEL 5513**

UNDERWRITERS LABORATORIES, INC.™
CLASSIFIED
FIRE DAMPER No. [REDACTED]
FIRE RESISTANCE RATING 1-1/2 HOUR

**VENT
PRODUCTS
CO., INC.**

California Fire Marshal
Listing No. 3225-1078:100

ALL DAMPERS 1/4" UNDER LISTED DIMENSIONS

MINIMUM SIZE: 4" x 4"

MAXIMUM DUCT OPENING

SINGLE SECTION:

VERTICAL: 41" x 36" or 36" x 60"

HORIZONTAL: 41" x 36"

MAXIMUM MULTIPLE SECTION

Not available

Sizes shown are for Type A construction.
Consult factory for Type B, Type C and Type CR.

SPECIAL TYPES: Variations of 2" deep channel frame are available incorporating the Type B, Type C or Type CR construction: Models 5522, 5523, 5532, 5533, 5542, 5543, 5552 and 5553.

MATERIALS: Standard construction – galvanized steel.

Specifications for all material per Underwriters Laboratories Standard for Safety UL 555.

UNDERWRITERS LABORATORIES: Labeled for use in sizes no larger than shown in UL Building Materials List in a 2-hour fire partition.

Meets N.F.P.A. 90A Requirements

Optional 304 Stainless Steel Construction available

Optional 212°F Fusible Link available